

April 17, 2013

**Test Report Number: 3030592CRT-095**  
Project Number: 3030592




**Legrand North America**  
125 Eugene O'Neill Drive  
New London, CT 06320  
Ph (860) 445-3800  
Fax (860) 405-2970

**TEST:**

Electrical transmission performance testing of a cabling configuration to the requirements of ANSI/TIA-568-C.2 Balanced Twisted-Pair Telecommunication Cabling and Component Standards for Category 6 Channel.

**SAMPLE DESCRIPTION:**

The client supplied and tested a 2-Connector channel as illustrated below and referenced to as "nCompass CAT 6e+ U/UTP Channel, 2-Connector, 7 meters (21 ft)".

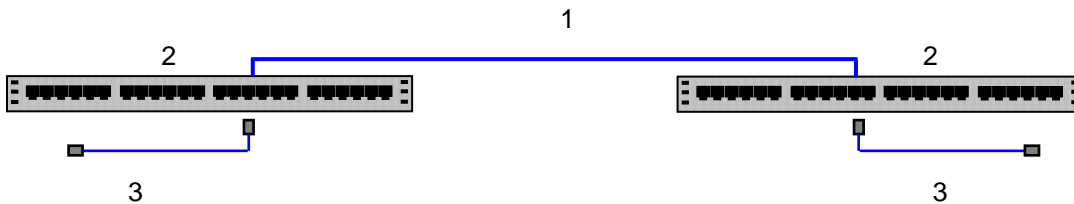

<u>Component ID</u>	<u>Manufacturer</u>	<u>Part Number</u>	<u>Length/Qty</u>	<u>Description</u>
1	Superior Essex	54-246-xB	5 m (15 ft)	NextGain Cable, C6eX U/UTP CMP
2	Ortronics, Inc.	OR-PHD66U24	2	Clarity C6 24 Port Patch Panel
3	Ortronics, Inc.	OR-MC603-09	1m (3 ft) /2	Clarity C6 U/UTP Patch Cords

**STANDARD USED:**

ANSI/TIA-568-C.2-2009: Balanced Twisted-Pair Telecommunications Cabling and Components Standard, dated August 2009

Note: U/UTP is a newer designation for LAN UTP cable construction.

**SECTIONS:**

6.2: Channel transmission performance (6.2.1 to 6.2.26)

**AUTHORIZATION:**

The project was authorized by Mr. Rob Aekins RCDD, representing Legrand Data Communications Incorporated

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only the sample tested. This report by itself does not imply that the material, product or service is or has ever been under an Intertek certification program.





Ortronics

Test report number 3030592CRT-095  
April 17, 2013

**EQUIPMENT LIST:**

The following equipment was employed in conducting the tests.

<u>Equipment used</u>	<u>Model number</u>	<u>Serial number</u>	<u>Calibration date</u>	<u>Calibration due date</u>
Agilent Technologies Network Analyzer	E5071B	MY42403324	06/01/2012	06/01/2013
Hewlett Packard Multimeter	34401A	US36035667	06/01/2012	06/01/2013

**DATE OF TEST:**

April 2, 2013

**TEST REPORT REVISION HISTORY:**

First Issue: April 17, 2013 Original Document

**RESULTS:** See appendixes A through C for the test results.

**CONCLUSION:**

The channel cabling configuration, as previously described and supplied by the client, was tested in accordance with the standard referred to herein, and did comply with the indicated applicable transmission requirements.

The procedures and requirements from the standard were followed, and the testing was performed at the client's facility as part of their qualifications under Intertek's SAT program.

Reviewed and Approved By:

Antoine Pelletier  
Engineer  
Global Cabling Products Testing

John Cash  
Technician  
Global Cabling Products Testing



Ortronics

Test report number 3030592CRT-095  
April 17, 2013

## **Appendix A**


Test results

Internal (core) transmission characteristics

This appendix contains 5 pages.




NEXT as measured from the TELECOMMUNICATIONS ROOM (TR)

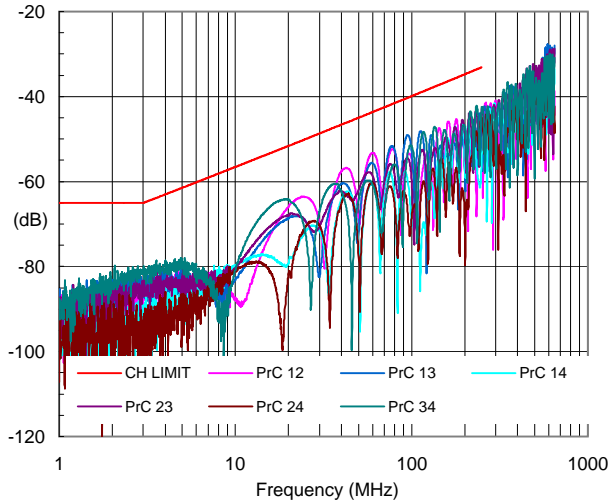

Worst Case Margin				
	Frequency Calculated Point (MHz)	Measured Margin (dB)	Measured Value (dB)	CH LIMIT Value (dB)
Swept Freq	33.6	8.6	42.2	33.6
Discrete Points	1.00	22.5	87.5	65.0
	4.00	18.2	81.3	63.0
	8.00	23.5	81.7	58.2
	10.00	23.3	79.9	56.6
	16.00	12.4	65.7	53.2
	20.00	12.6	64.2	51.6
	25.00	13.6	63.6	50.0
	31.25	16.0	64.4	48.4
	62.50	10.6	54.0	43.4
	100.00	11.7	51.6	39.9
	200.00	12.4	47.1	34.8
	250.00	9.9	43.0	33.1
	300.00		41.0	n/a
	400.00		39.5	n/a
500.00		37.8	n/a	
650.00		27.9	n/a	


NEXT as measured from the WORK AREA (WA)

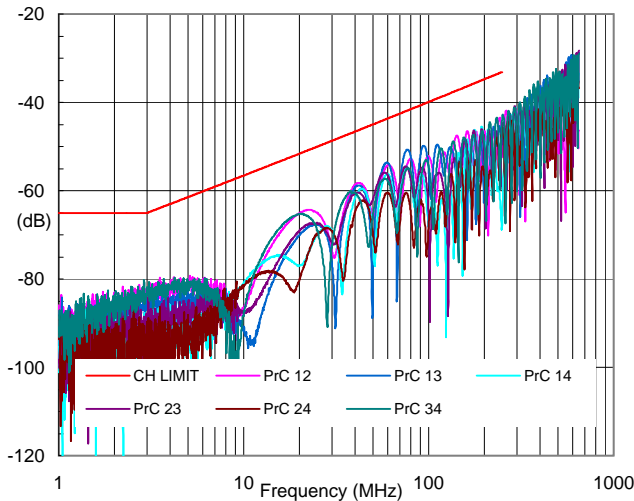

Worst Case Margin				
	Frequency Calculated Point (MHz)	Measured Margin (dB)	Measured Value (dB)	CH LIMIT Value (dB)
Swept Freq	76.7	8.8	50.7	41.9
Discrete Points	1.00	20.9	85.9	65.0
	4.00	19.0	82.0	63.0
	8.00	26.5	84.7	58.2
	10.00	24.3	80.9	56.6
	16.00	14.8	68.0	53.2
	20.00	13.5	65.1	51.6
	25.00	15.0	65.0	50.0
	31.25	19.8	68.2	48.4
	62.50	11.1	54.5	43.4
	100.00	12.3	52.3	39.9
	200.00	11.7	46.5	34.8
	250.00	10.4	43.5	33.1
	300.00		42.1	n/a
	400.00		36.5	n/a
500.00		35.5	n/a	
650.00		28.3	n/a	




PSNEXT as measured from the TELECOMMUNICATIONS ROOM (TR)

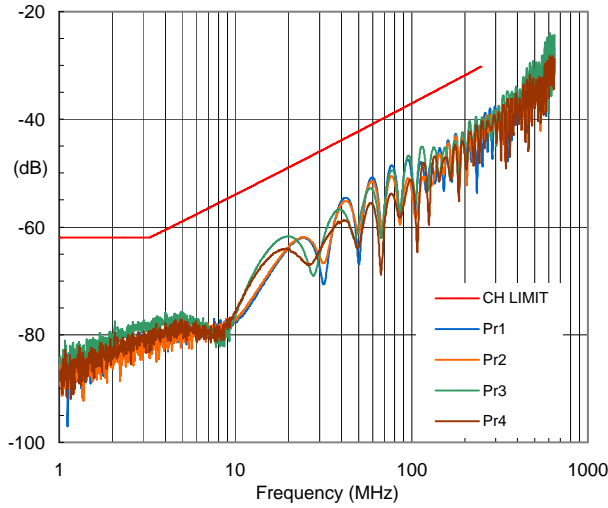

Worst Case Margin				
	Frequency Point (MHz)	Calculated Margin (dB)	Calculated Value (dB)	CH LIMIT Value (dB)
Swept Freq	232.4	8.8	39.5	30.7
Discrete Points	1.00	23.4	85.4	62.0
	4.00	17.6	78.1	60.5
	8.00	22.8	78.4	55.6
	10.00	21.8	75.8	54.0
	16.00	13.0	63.6	50.6
	20.00	12.8	61.7	49.0
	25.00	14.6	62.0	47.3
	31.25	17.2	62.9	45.7
	62.50	11.2	51.8	40.6
	100.00	11.6	48.7	37.1
	200.00	12.8	44.7	31.9
	250.00	9.7	39.9	30.2
	300.00		38.5	n/a
	400.00		35.3	n/a
	500.00		34.7	n/a
	650.00		24.3	n/a


PSNEXT as measured from the WORK AREA (WA)

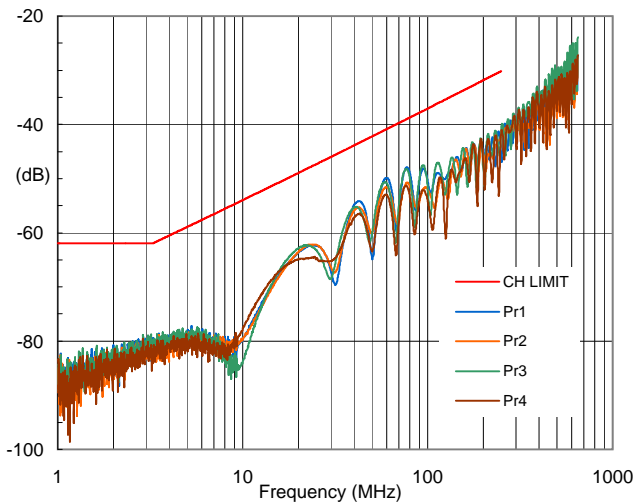

Worst Case Margin				
	Frequency Point (MHz)	Calculated Margin (dB)	Calculated Value (dB)	CH LIMIT Value (dB)
Swept Freq	77.0	8.9	47.9	39.0
Discrete Points	1.00	23.0	85.0	62.0
	4.00	20.1	80.6	60.5
	8.00	24.6	80.2	55.6
	10.00	23.8	77.8	54.0
	16.00	16.1	66.7	50.6
	20.00	13.9	62.9	49.0
	25.00	14.9	62.2	47.3
	31.25	19.2	64.9	45.7
	62.50	10.2	50.8	40.6
	100.00	13.3	50.4	37.1
	200.00	13.4	45.3	31.9
	250.00	10.9	41.0	30.2
	300.00		39.0	n/a
	400.00		34.6	n/a
	500.00		33.2	n/a
	650.00		23.9	n/a




RL as measured from the TELECOMMUNICATIONS ROOM (TR)

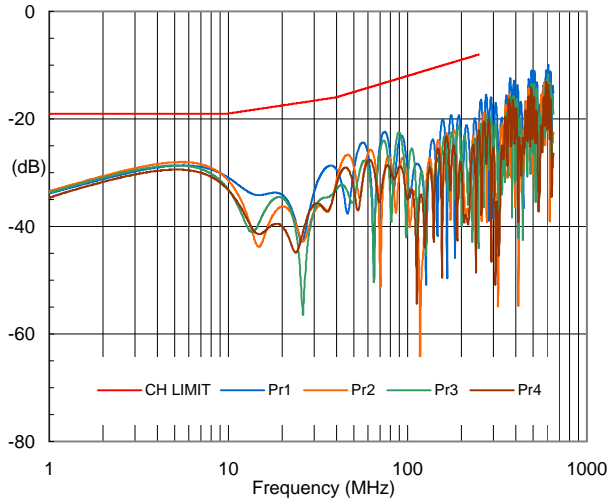

Worst Case Margin				
	Frequency Point (MHz)	Calculated Margin (dB)	Measured Value (dB)	CH LIMIT Value (dB)
Swept Freq	5.8	9.0	28.0	19.0
Discrete Points	1.00	14.4	33.4	19.0
	4.00	9.4	28.4	19.0
	8.00	10.1	29.1	19.0
	10.00	11.9	30.9	19.0
	16.00	16.1	34.0	18.0
	20.00	16.7	34.2	17.5
	25.00	24.7	41.7	17.0
	31.25	15.4	31.9	16.5
	62.50	11.7	25.8	14.0
	100.00	18.0	30.0	12.0
	200.00	16.8	25.7	9.0
	250.00	12.6	20.6	8.0
	300.00		24.8	n/a
	400.00		19.4	n/a
500.00		19.1	n/a	
650.00		15.1	n/a	


RL as measured from the WORK AREA (WA)

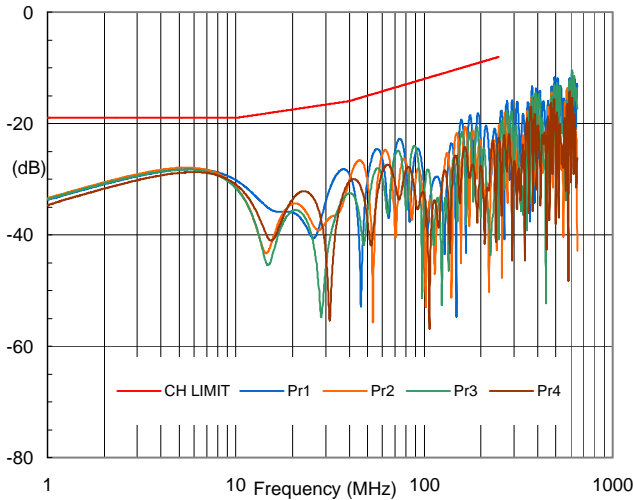

Worst Case Margin				
	Frequency Point (MHz)	Calculated Margin (dB)	Measured Value (dB)	CH LIMIT Value (dB)
Swept Freq	5.5	8.9	27.9	19.0
Discrete Points	1.00	14.5	33.5	19.0
	4.00	9.3	28.3	19.0
	8.00	9.8	28.8	19.0
	10.00	11.2	30.2	19.0
	16.00	17.8	35.7	18.0
	20.00	16.1	33.6	17.5
	25.00	15.8	32.8	17.0
	31.25	15.6	32.2	16.5
	62.50	10.7	24.8	14.0
	100.00	19.9	31.9	12.0
	200.00	14.5	23.5	9.0
	250.00	12.4	20.4	8.0
	300.00		21.7	n/a
	400.00		21.9	n/a
500.00		21.7	n/a	
650.00		13.3	n/a	




ACRF

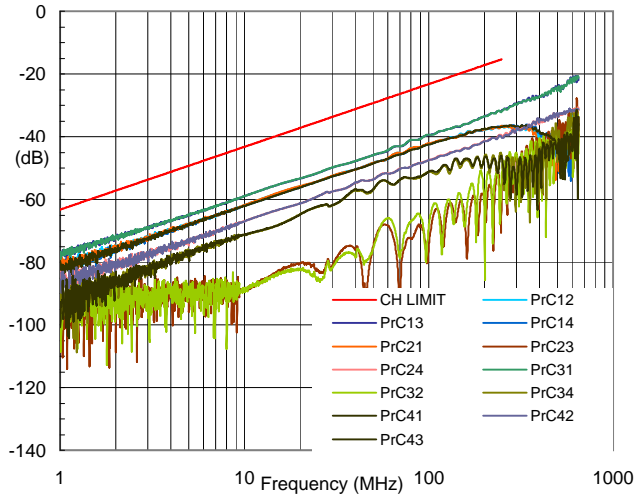

Worst Case Margin

	Frequency Point (MHz)	Calculated Margin (dB)	Measured Value (dB)	CH LIMIT Value (dB)
Swept Freq	1.1	13.0	75.8	62.9
Discrete Points	1.00	13.4	76.7	63.3
	4.00	15.7	66.9	51.2
	8.00	15.8	61.0	45.2
	10.00	15.8	59.0	43.3
	16.00	15.7	54.9	39.2
	20.00	16.1	53.3	37.2
	25.00	16.3	51.6	35.3
	31.25	16.1	49.5	33.4
	62.50	16.3	43.7	27.3
	100.00	16.1	39.4	23.3
	200.00	16.3	33.5	17.2
	250.00	16.4	31.7	15.3
	300.00		29.6	n/a
	400.00		27.2	n/a
500.00		24.8	n/a	
650.00		21.2	n/a	

PSACRF

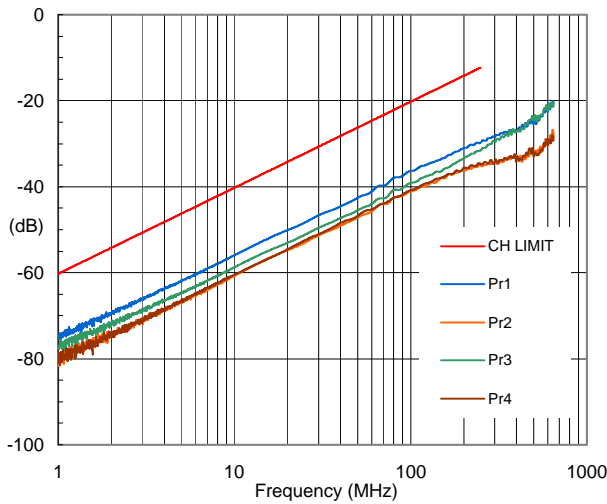


Worst Case Margin

	Frequency Point (MHz)	Calculated Margin (dB)	Calculated Value (dB)	CH LIMIT Value (dB)
Swept Freq	1.2	13.7	72.6	59.0
Discrete Points	1.00	13.9	74.2	60.3
	4.00	15.5	63.8	48.2
	8.00	15.7	57.9	42.2
	10.00	15.7	56.0	40.3
	16.00	15.6	51.8	36.2
	20.00	15.9	50.1	34.2
	25.00	16.1	48.4	32.3
	31.25	16.0	46.4	30.4
	62.50	16.2	40.5	24.3
	100.00	16.1	36.3	20.3
	200.00	16.8	31.0	14.2
	250.00	17.4	29.7	12.3
	300.00		28.4	n/a
	400.00		26.8	n/a
500.00		24.7	n/a	
650.00		20.7	n/a	



INSERTION LOSS (ATTN)

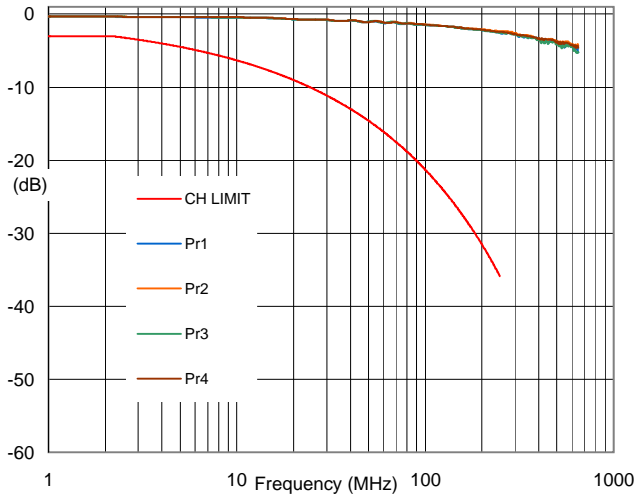

Worst Case Margin

	Frequency Point (MHz)	Calculated Margin (dB)	Measured Value (dB)	CH LIMIT Value (dB)
Swept Freq	2.15	2.65	0.35	3.00
Discrete Points	1.00	2.68	0.3	3.0
	4.00	3.61	0.4	4.0
	8.00	5.19	0.5	5.7
	10.00	5.85	0.5	6.3
	16.00	7.47	0.6	8.0
	20.00	8.30	0.7	9.0
	25.00	9.35	0.8	10.1
	31.25	10.53	0.9	11.4
	62.50	15.25	1.2	16.5
	100.00	19.81	1.5	21.3
	200.00	29.34	2.2	31.5
	250.00	33.35	2.6	36.0
	300.00		2.8	n/a
	400.00		3.5	n/a
	500.00		4.0	n/a
	650.00		5.3	n/a

GLOSSARY of TERMS

- Calculated Margin:** The minimum difference in dB between the measured value and the LIMIT value at the specified frequency point for all tested pairs ( $CalculateMargin@100MHz = MeasuredValue@100MHz - LIMITValue@100MHz$  (dB)).
- Discrete Points:** Specific reference points of interest in MHz within the swept frequencies.
- Frequency Point:** A specific frequency point in megahertz (MHz) for which the data indicated is applicable.
- LIMIT Value:** The calculated response LIMIT in dB at the indicated frequency point as calculated using applicable equations defined by the appropriate standard.
- Measured Value:** The worst case measured response in dB at the frequency indicated for all tested pairs.
- Swept Freq:** The band of measured values from 1 MHz to the upper frequency LIMIT as defined by the category of test.
- Swept Freq (Margin):** The minimum margin in dB detected across the Swept Frequency band.
- Worst Case:** A composite value calculated from the maximum response of each pair or pair combination at a given frequency. ( $WorstCase_{100MHz} = Max(Pr1_{100MHz}, Pr2_{100MHz}, Pr3_{100MHz}, Pr4_{100MHz})$  etc.
- ACR / PSACR:** If Provided are for reference only. Limit line(s) are provided for reference and are calculated as the difference between the applicable NEXT Loss and Insertion loss limits ( $ACR_{limit} = NEXT_{limit} - II_{limit}$ ).





Ortronics

Test report number 3030592CRT-095  
April 17, 2013

**Appendix B**


Test results

ACR transmission performance provided for reference ONLY

This appendix contains 2 pages.




Pair-to-Pair ACR as measured from the TELECOMMUNICATIONS ROOM (TR)

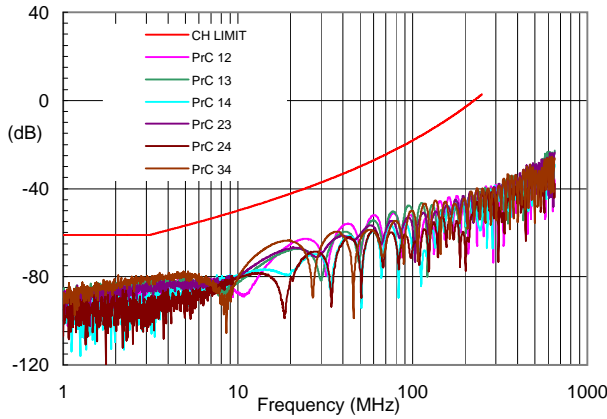

Worst Case Margin				
	Frequency Point (MHz)	Calculated Margin (dB)	Calculated Value (dB)	CH LIMIT Value (dB)
Swept Freq	3.6	18.4	-78.2	-59.9
Discrete Points	1.00	26.2	-87.2	-61.0
	4.00	22.0	-80.9	-58.9
	8.00	29.0	-81.3	-52.3
	10.00	29.4	-79.4	-50.0
	16.00	20.2	-65.1	-44.9
	20.00	21.2	-63.5	-42.3
	25.00	23.3	-62.9	-39.6
	31.25	26.9	-63.6	-36.7
	62.50	26.3	-52.8	-26.5
	100.00	31.9	-50.2	-18.2
	200.00	42.0	-45.0	-3.1
	250.00	43.4	-40.6	2.8
	300.00		-38.4	n/a
	400.00		-36.0	n/a
	500.00		-33.8	n/a
	650.00		-22.6	n/a

NOTE: Limit line/values provided for reference ONLY and are extrapolated from NEXT Loss and IL limit requirements.  $ACR_{limit} = NEXT_{limit} - IL_{limit}$


Pair-to-Pair ACR as measured from the WORK AREA (WA)

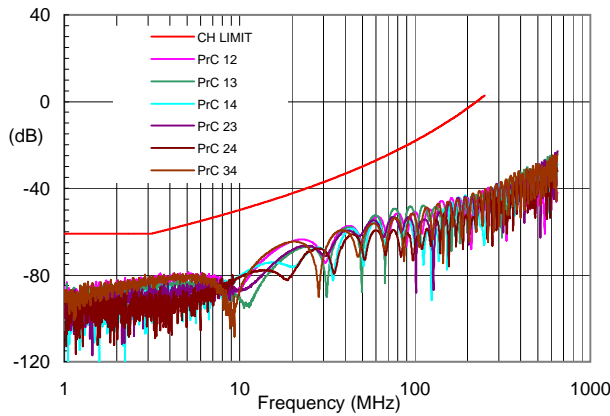

Worst Case Margin				
	Frequency Point (MHz)	Calculated Margin (dB)	Calculated Value (dB)	CH LIMIT Value (dB)
Swept Freq	2.9	19.0	-80.0	-61.0
Discrete Points	1.00	24.6	-85.6	-61.0
	4.00	22.8	-81.6	-58.9
	8.00	31.9	-84.2	-52.3
	10.00	30.5	-80.5	-50.0
	16.00	22.6	-67.5	-44.9
	20.00	22.1	-64.4	-42.3
	25.00	24.7	-64.3	-39.6
	31.25	30.8	-67.4	-36.7
	62.50	26.8	-53.3	-26.5
	100.00	32.7	-50.9	-18.2
	200.00	41.4	-44.5	-3.1
	250.00	43.8	-41.0	2.8
	300.00		-39.5	n/a
	400.00		-33.0	n/a
	500.00		-31.5	n/a
	650.00		-23.0	n/a



**Power Sum (PS) ACR as measured from the TELECOMMUNICATIONS ROOM (TR)**

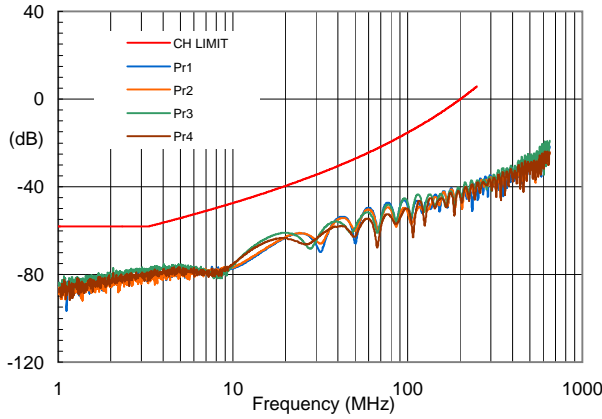


**Worst Case Margin**

	Frequency Point (MHz)	Calculated Margin (dB)	Calculated Value (dB)	CH LIMIT Value (dB)
Swept Freq	3.4	18.8	-76.6	-57.8
Discrete Points	1.00	27.1	-85.1	-58.0
	4.00	21.4	-77.7	-56.4
	8.00	28.2	-78.0	-49.7
	10.00	27.9	-75.4	-47.4
	16.00	20.8	-63.1	-42.3
	20.00	21.3	-61.0	-39.7
	25.00	24.4	-61.3	-36.9
	31.25	28.1	-62.1	-34.0
	62.50	26.9	-50.6	-23.7
	100.00	31.8	-47.2	-15.4
	200.00	42.4	-42.5	-0.1
	250.00	43.0	-37.3	5.8
	300.00		-35.6	n/a
	400.00		-31.9	n/a
500.00		-30.9	n/a	
650.00		-19.0	n/a	

**NOTE:** Limit line/values provided for reference ONLY and are extrapolated from PSNEXT Loss and IL limit requirements.  $psACR_{limit} = psNEXT_{limit} - IL_{limit}$

**Power Sum (PS) ACR as measured from the WORK AREA (WA)**

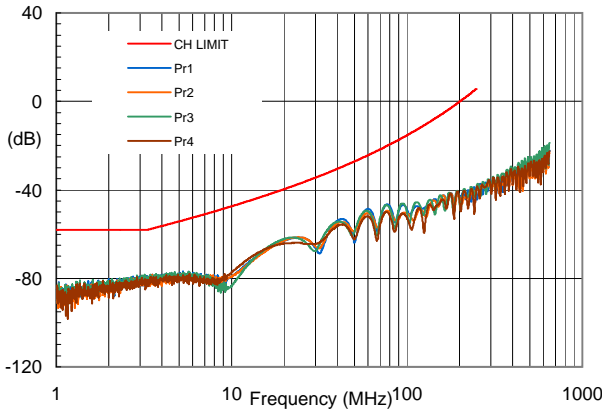

**Worst Case Margin**

	Frequency Point (MHz)	Calculated Margin (dB)	Calculated Value (dB)	CH LIMIT Value (dB)
Swept Freq	3.2	20.4	-78.4	-58.0
Discrete Points	1.00	26.7	-84.7	-58.0
	4.00	23.9	-80.2	-56.4
	8.00	30.0	-79.7	-49.7
	10.00	29.9	-77.4	-47.4
	16.00	23.8	-66.1	-42.3
	20.00	22.5	-62.2	-39.7
	25.00	24.6	-61.5	-36.9
	31.25	30.1	-64.1	-34.0
	62.50	25.8	-49.5	-23.7
	100.00	33.6	-48.9	-15.4
	200.00	43.0	-43.1	-0.1
	250.00	44.2	-38.4	5.8
	300.00		-36.2	n/a
	400.00		-31.1	n/a
500.00		-29.3	n/a	
650.00		-18.6	n/a	